



Angola



Energy efficiency benefits from lighting, residential refrigerators, room air conditioners, power and distribution transformers and industrial electric motors with the implementation of globally benchmarked minimum energy performance standards.

ANNUAL SAVINGS IN 2030



Reduce electricity use

→ by over **2 TWh**

→ **12.5%** of future national electricity use



Save electricity worth

80 Million USD

equivalent to **4 Power Plants [100MW]**



Reduce CO₂ emissions by

810 Thousand Tonnes

equivalent to **450 Thousand Passenger Cars**



SHARE OF EACH TYPE PRODUCT TO THE COUNTRY'S TOTAL SAVINGS IN 2030



29%

Lighting



21%

Residential Refrigerators



10%

Room Air Conditioners



32%


Transformer



8%

Industrial Electric Motor



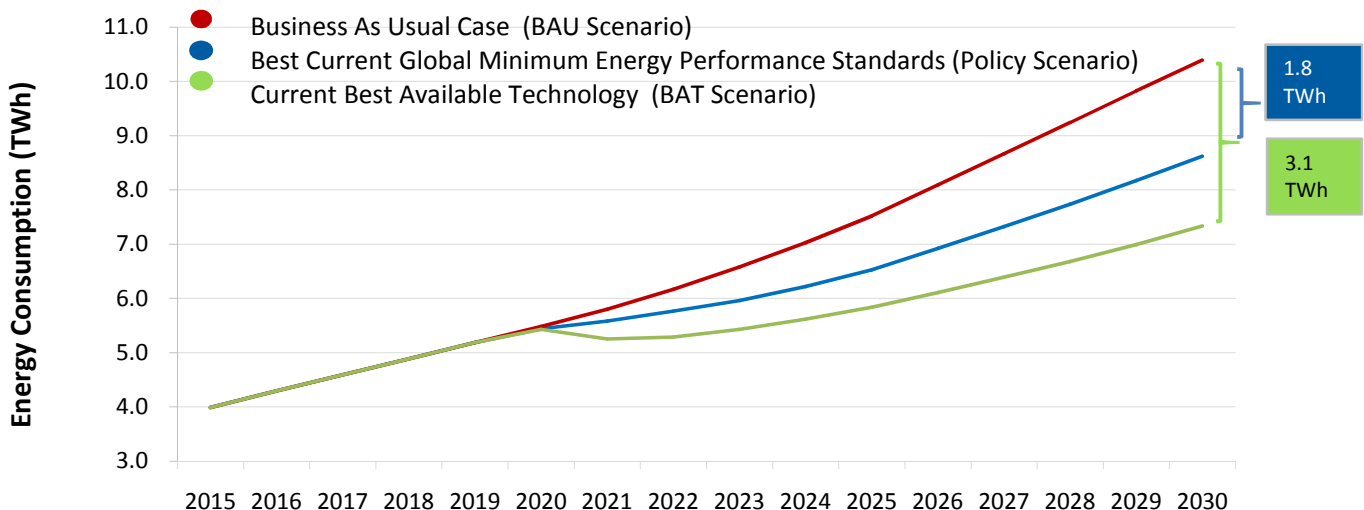





EVEN GREATER SAVINGS POSSIBLE WITH BEST AVAILABLE TECHNOLOGY











THE PATHWAY TO ENERGY EFFICIENCY






ANNUAL SAVINGS IN 2025 AND 2030

											
		Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
		2025	2030	2025	2030	2025	2030	2025	2030	2025	2030
	Electricity (GWh)	433.4	507.8	151.7	372.0	82.6	188.5	268.9	559.1	54.9	139.2
	Electricity Bills (million US\$)	19.5	22.9	6.8	16.7	3.7	8.5	12.1	25.2	2.4	6.0
	CO2 Emissions (thousand tonnes)	204.7	239.9	71.7	175.7	39.0	89.0	115.4	239.9	25.9	65.8

CUMULATIVE SAVINGS (2020 - 2030)

											
		Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
		2025	2030	2025	2030	2025	2030	2025	2030	2025	2030
	Electricity (TWh)	4.0		1.8		1.0		3.1		0.7	
	Electricity Bills (million US\$)	177.9		82.0		43.3		139.2		28.8	
	CO2 Emissions (million tonnes)	1.9		0.9		0.5		1.3		0.3	

OTHER BENEFITS IN 2030

	Direct GHG emissions reduced by	→	1 Million Tonnes
	Increased grid connection to	→	883 Thousand Households
	Reduced electricity subsidies by	→	136 Million USD

ENERGY EFFICIENCY STRATEGY AND NATIONALLY DETERMINED CONTRIBUTION

Country Nationally Determined Contribution (NDC): Angola plans to reduce GHG emissions up to 35% unconditionally by 2030 as compared to the BAU scenario (base year 2005). In addition, it is expected that through a conditional mitigation scenario the country could reduce an additional 15% below BAU emission levels by 2030.

Country Specific Data and Input Assumptions For Angola



GENERAL INFORMATION

Population	22.1 million
GDP per capita	5,936 US\$
Electrification level	30%
CO2 Emission Factor	0.429 kg / kWh

ELECTRICITY MARKET

Residential Electricity tariff	0.045 US\$ / kWh
Industrial Electricity tariff	0.043 US\$ / kWh
Transmission and distribution loss factor	9.18%

ASSUMPTIONS

Product	Unit Energy Consumption (kWh/year) or Efficiency Level			Type of Product
	BAU	Policy Scenario	BAT	
Lighting	65.7	15.3	8.8	Low incandescent Lamp,3h/day; 14W CFL; 8W LED
Residential Refrigerators	325	191	134	2-door top-mount Average size 225 liters
Room Air Conditioners	2,168	1,768	1,159	Split unit with 3.5 kW cooling capacity
Transformers	N/A	SEAD Tier3	SEAD Tier5	three-phase and single-phase liquid-filled and three-phase dry-type power and distribution transformers
Industrial Electric Motors	IE1/IE0	IE3	IE4	3-phase induction motors Ranging from: 0.75 - 7.5 kW; 7.5 - 75 kW; 75 - 375 kW

METHODOLOGY

The analysis uses CLASP's and Lawrence Berkeley National Laboratory's Policy Analysis Modeling System (PAMS) to forecast the impacts from implementing policies that improve the energy efficiency of new household air conditioners and refrigerators. For lighting, electric motors, and power and distribution transformers individual - models were developed, taking into account country level data, expected GDP growth, and industrialization levels. The savings potential assumes minimum energy performance standards (MEPS) are implemented in 2020 at level equivalent to the present day (2015) best global MEPS that are currently implemented. The graph on page two also shows the savings potential that is possible with the implementation of MEPS in 2020 at level equivalent to the present day best available technology (BAT).

ASSUMPTIONS AND DATA SOURCES

- Population and GDP per capita data (2014) comes from the World Bank.
- Electrification levels come from the International Energy Agency (IEA).
- Market size was determined by data provided by industry partners; UN Comtrade database; household penetration forecasts generated by PAMS from population, climate, and macroeconomic indicators.
- Future electricity consumption was calculated using current consumption figures provided by the IEA and the U.S. Energy Information Administration (EIA).
- Baseline price, unit energy consumption (UEC), appliance lifetime were provided by country representatives (when available); industry partners; and Lawrence Berkeley National Laboratory. The business-as-usual scenario assumes a 1 per cent annual improvement in UEC.
- Electricity tariffs were provided by the IEA; and Internet research.
- Transmission and distribution loss factor is a regional average calculated from electricity production and consumption data published by the IEA.
- CO2 emission factor came from the IEA and extrapolations were made for countries lacking data.
- Consumer discount rate was derived from the Human Development Index, United Nations Development Programme (2012).
- The approach of calculating the potential direct emission saving of refrigerators and air conditioners: the typical current mix of refrigerants fillings, leakage rates and end of life emissions in the BAU compared to the best alternative with natural refrigerants (mostly R290 for splits and R600a for domestic refrigerators).
- Additional to the above sources, a questionnaire was used to gather data from country officials.

