



Russian Federation



Energy efficiency benefits from lighting, residential refrigerators, room air conditioners, power and distribution transformers and industrial electric motors with the implementation of globally benchmarked minimum energy performance standards.

ANNUAL SAVINGS IN 2030



Reduce electricity use

→ by over **55 TWh**

→ **4.5%** of future national electricity use



Save electricity worth **60 Million USD**

equivalent to **25 Power Plants [500MW]**



Reduce CO₂ emissions by **30 Million Tonnes**

equivalent to **10 Million Passenger Cars**



SHARE OF EACH TYPE PRODUCT TO THE COUNTRY'S TOTAL SAVINGS IN 2030



36%

Lighting



10%

Residential Refrigerators



5%

Room Air Conditioners



17%


Transformer



32%

Industrial Electric Motor



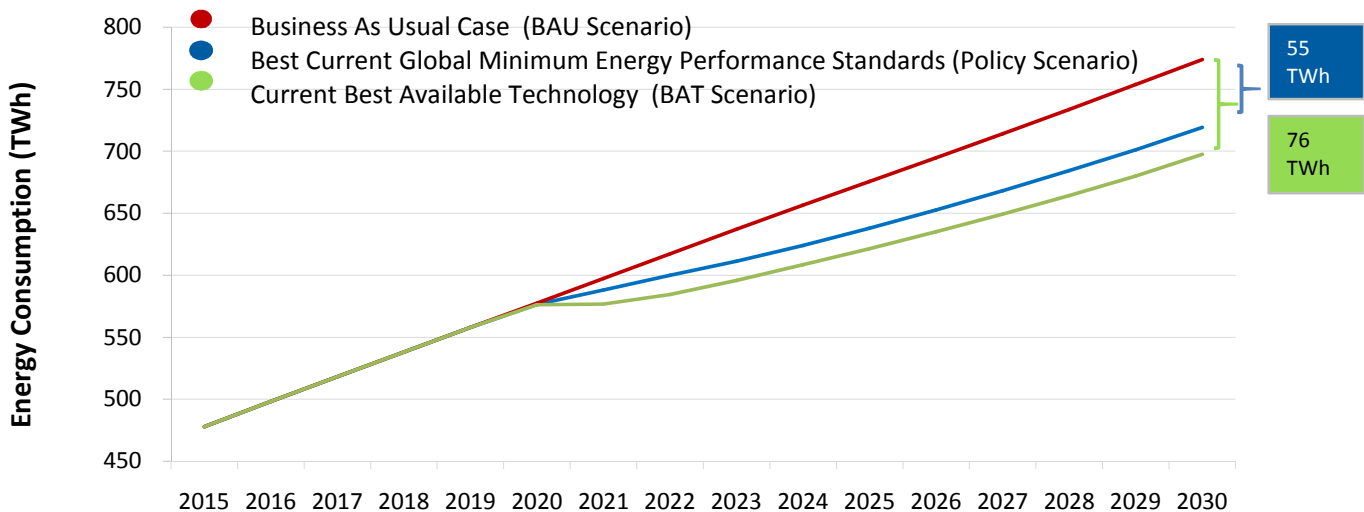





EVEN GREATER SAVINGS POSSIBLE WITH BEST AVAILABLE TECHNOLOGY











THE PATHWAY TO ENERGY EFFICIENCY




ANNUAL SAVINGS IN 2025 AND 2030

										
	Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
	2025	2030	2025	2030	2025	2030	2025	2030	2025	2030
 Electricity (TWh)	20.1	19.6	3.1	5.7	1.1	2.3	5.1	9.6	8.4	17.6
 Electricity Bills (million US\$)	22.1	21.6	3.5	6.3	1.2	2.5	5.6	10.5	9.3	19.4
 CO2 Emissions (thousand tonnes)	9,671.8	9,444.0	1,510.4	2,738.3	531.8	1,110.9	2,141.3	3,995.9	4,064.4	8,488.0

CUMULATIVE SAVINGS (2020 - 2030)

										
	Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
 Electricity (TWh)	172.1		33.1		12.4		56.8		94.5	
 Electricity Bills (million US\$)	189.3		36.5		13.6		62.5		103.9	
 CO2 Emissions (million tonnes)	82.9		16.0		6.0		23.7		45.5	

OTHER BENEFITS IN 2030

	Direct GHG emissions reduced by	→	2 Million Tonnes
	Reduced electricity subsidies by	→	1 Billion USD
	Reduced emissions by	→	SO2 55 Thousand Tonnes NOx 30 Thousand Tonnes

ENERGY EFFICIENCY STRATEGY AND NATIONALLY DETERMINED CONTRIBUTION

The presidential decree of 4 June 2008 No. 889, On Certain Measures Aimed at Enhancing Energy and Environmental Efficiency of the Russian Economy, set the ambitious target of decreasing the energy intensity of Russia's GDP by no less than 40% by 2020 (from 2007). The governmental programme of Russia "On Energy Efficiency and the Development of Energy developed by the Ministry of Energy and approved by the government of Russia on 3 April 2013 sets a number of specific measures to decrease the energy intensity of Russia's GDP by 13.5% by 2020 from 2007.

Country Nationally Determined Contribution (NDC): 25-30% domestic reduction in greenhouse gases by 2030 compared to 1990 levels.

Country Specific Data and Input Assumptions

For Russian Federation



GENERAL INFORMATION

Population	143.8 million
GDP per capita	23,293 US\$
Electrification level	100%
CO2 Emission Factor	0.417 kg / kWh

ELECTRICITY MARKET

Residential Electricity tariff	0.001 US\$ / kWh
Industrial Electricity tariff	0.001 US\$ / kWh
Transmission and distribution loss factor	13.41%

ASSUMPTIONS

Product	Unit Energy Consumption (kWh/year) or Efficiency Level			Type of Product
	BAU	Policy Scenario	BAT	
Lighting	65.7	15.3	8.8	Low incandescent Lamp,3h/day; 14W CFL; 8W LED
Residential Refrigerators	450	212	139	2-door top-mount Average size 300 liters
Room Air Conditioners	752	461	302	Split unit with 3.5 kW cooling capacity
Transformers	N/A	SEAD Tier3	SEAD Tier5	three-phase and single-phase liquid-filled and three-phase dry-type power and distribution transformer
Industrial Electric Motors	IE1/IE0	IE3	IE4	3-phase induction motors Ranging from: 0.75 - 7.5 kW; 7.5 - 75 kW;75 - 375 kW

METHODOLOGY

The analysis uses CLASP's and Lawrence Berkeley National Laboratory's Policy Analysis Modeling System (PAMS) to forecast the impacts from implementing policies that improve the energy efficiency of new household air conditioners and refrigerators. For lighting, electric motors, and power and distribution transformers individual - models were developed, taking into account country level data, expected GDP growth, and industrialization levels. The savings potential assumes minimum energy performance standards (MEPS) are implemented in 2020 at level equivalent to the present day (2015) best global MEPS that are currently implemented. The graph on page two also shows the savings potential that is possible with the implementation of MEPS in 2020 at level equivalent to the present day best available technology (BAT).

ASSUMPTIONS AND DATA SOURCES

- Population and GDP per capita data (2014) comes from the World Bank.
- Electrification levels come from the International Energy Agency (IEA).
- Market size was determined by data provided by industry partners; UN Comtrade database; household penetration forecasts generated by PAMS from population, climate, and macroeconomic indicators.
- Future electricity consumption was calculated using current consumption figures provided by the IEA and the U.S. Energy Information Administration (EIA).
- Baseline price, unit energy consumption (UEC), appliance lifetime were provided by country representatives (when available); industry partners; and Lawrence Berkeley National Laboratory. The business-as-usual scenario assumes a 1 per cent annual improvement in UEC.
- Electricity tariffs were provided by the IEA; and Internet research.
- Transmission and distribution loss factor is a regional average calculated from electricity production and consumption data published by the IEA.
- CO2 emission factor came from the IEA and extrapolations were made for countries lacking data.
- Consumer discount rate was derived from the Human Development Index, United Nations Development Programme (2012).
- The approach of calculating the potential direct emission saving of refrigerators and air conditioners: the typical current mix of refrigerants fillings, leakage rates and end of life emissions in the BAU compared to the best alternative with natural refrigerants (mostly R290 for splits and R600a for domestic refrigerators).
- Additional to the above sources, a questionnaire was used to gather data from country officials.

