



# Viet Nam



Energy efficiency benefits from lighting, residential refrigerators, room air conditioners, power and distribution transformers and industrial electric motors with the implementation of globally benchmarked minimum energy performance standards.

## ANNUAL SAVINGS IN 2030



Reduce electricity use

→ by over **16 TWh**

→ **7.2%** of future national electricity use



Save electricity worth **1 Billion USD**

equivalent to **7 Power Plants [500MW]**



Reduce CO<sub>2</sub> emissions by **7 Million Tonnes**

equivalent to **4 Million Passenger Cars**



## SHARE OF EACH TYPE PRODUCT TO THE COUNTRY'S TOTAL SAVINGS IN 2030



10%

Lighting



23%

Residential Refrigerators



7%

Room Air Conditioners



20%


Transformer



40%

Industrial Electric Motor

## EVEN GREATER SAVINGS POSSIBLE WITH BEST AVAILABLE TECHNOLOGY

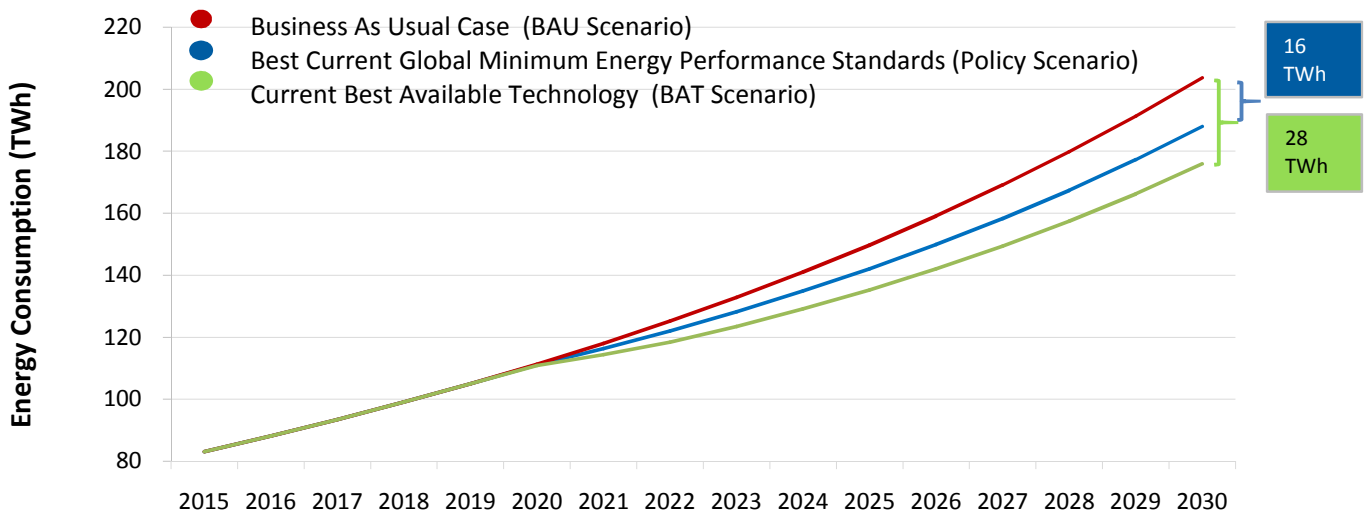

# THE PATHWAY TO ENERGY EFFICIENCY



## ANNUAL SAVINGS IN 2025 AND 2030

		Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
		2025	2030	2025	2030	2025	2030	2025	2030	2025	2030
	Electricity (GWh)	1,182.8	1,565.1	1,767.0	3,561.6	558.5	1,099.4	1,629.2	3,189.2	2,499.4	6,275.2
	Electricity Bills (million US\$)	106.5	140.9	159.0	320.5	50.3	98.9	146.6	287.0	199.9	502.0
	CO2 Emissions (thousand tonnes)	523.2	692.3	781.6	1,575.4	247.1	486.3	676.1	1,323.5	1,105.6	2,775.8

## CUMULATIVE SAVINGS (2020 - 2030)

		Lighting		Residential Refrigerators		Room Air Conditioners		Transformers		Industrial Electric Motors	
	Electricity (TWh)	11.3		19.5		6.1		18.3		30.3	
	Electricity Bills (billion US\$)	1.0		1.8		0.6		1.7		2.4	
	CO2 Emissions (million tonnes)	5.0		8.6		2.7		7.6		13.4	

## OTHER BENEFITS IN 2030

	Direct GHG emissions reduced by	→	<b>14 Million Tonnes</b>
	Reduced electricity subsidies by	→	<b>139 Million USD</b>
	Reduced emissions by	→	<b>SO2 20 Thousand Tonnes</b> <b>NOx 11 Thousand Tonnes</b>

## ENERGY EFFICIENCY STRATEGY AND NATIONALLY DETERMINED CONTRIBUTION

Country Nationally Determined Contribution (NDC): With domestic resources, by 2030 Viet Nam will reduce GHG emissions by 8% compared to BAU, in which:- Emission intensity per unit of GDP will be reduced by 20% compared to the 2010 levels; Forest cover will increase to the level of 45%.

The above-mentioned 8% contribution could be increased to 25% if international support is received through bilateral and unilateral cooperation, as well as through the implementation of new mechanisms under the Global Climate Agreement, in which emission intensity per unit of GDP will be reduced by 30% compared to 2010 levels.

# Country Specific Data and Input Assumptions For Viet Nam



## GENERAL INFORMATION

Population	90.7 million
GDP per capita	2,052 US\$
Electrification level	96%
CO2 Emission Factor	0.415 kg / kWh

## ELECTRICITY MARKET

Residential Electricity tariff	0.090 US\$ / kWh
Industrial Electricity tariff	0.080 US\$ / kWh
Transmission and distribution loss factor	6.18%

## ASSUMPTIONS

Product	Unit Energy Consumption (kWh/year) or Efficiency Level			Type of Product
	BAU	Policy Scenario	BAT	
Lighting	65.7	15.3	8.8	Low incandescent Lamp,3h/day; 14W CFL; 8W LED
Residential Refrigerators	352	207	159	2-door top-mount Average size 280 liters
Room Air Conditioners	1,838	1,545	1,015	Split unit with 3.5 kW cooling capacity
Transformers	N/A	SEAD Tier3	SEAD Tier5	three-phase and single-phase liquid-filled and three-phase dry-type power and distribution transformers
Industrial Electric Motors	IE1/IE0	IE3	IE4	3-phase induction motors Ranging from: 0.75 - 7.5 kW; 7.5 - 75 kW; 75 - 375 kW

### METHODOLOGY

The analysis uses CLASP's and Lawrence Berkeley National Laboratory's Policy Analysis Modeling System (PAMS) to forecast the impacts from implementing policies that improve the energy efficiency of new household air conditioners and refrigerators. For lighting, electric motors, and power and distribution transformers individual - models were developed, taking into account country level data, expected GDP growth, and industrialization levels. The savings potential assumes minimum energy performance standards (MEPS) are implemented in 2020 at level equivalent to the present day (2015) best global MEPS that are currently implemented. The graph on page two also shows the savings potential that is possible with the implementation of MEPS in 2020 at level equivalent to the present day best available technology (BAT).

### ASSUMPTIONS AND DATA SOURCES

- Population and GDP per capita data (2014) comes from the World Bank.
- Electrification levels come from the International Energy Agency (IEA).
- Market size was determined by data provided by industry partners; UN Comtrade database; household penetration forecasts generated by PAMS from population, climate, and macroeconomic indicators.
- Future electricity consumption was calculated using current consumption figures provided by the IEA and the U.S. Energy Information Administration (EIA).
- Baseline price, unit energy consumption (UEC), appliance lifetime were provided by country representatives (when available); industry partners; and Lawrence Berkeley National Laboratory. The business-as-usual scenario assumes a 1 per cent annual improvement in UEC.
- Electricity tariffs were provided by the IEA; and Internet research.
- Transmission and distribution loss factor is a regional average calculated from electricity production and consumption data published by the IEA.
- CO2 emission factor came from the IEA and extrapolations were made for countries lacking data.
- Consumer discount rate was derived from the Human Development Index, United Nations Development Programme (2012).
- The approach of calculating the potential direct emission saving of refrigerators and air conditioners: the typical current mix of refrigerants fillings, leakage rates and end of life emissions in the BAU compared to the best alternative with natural refrigerants (mostly R290 for splits and R600a for domestic refrigerators).
- Additional to the above sources, a questionnaire was used to gather data from country officials.

